


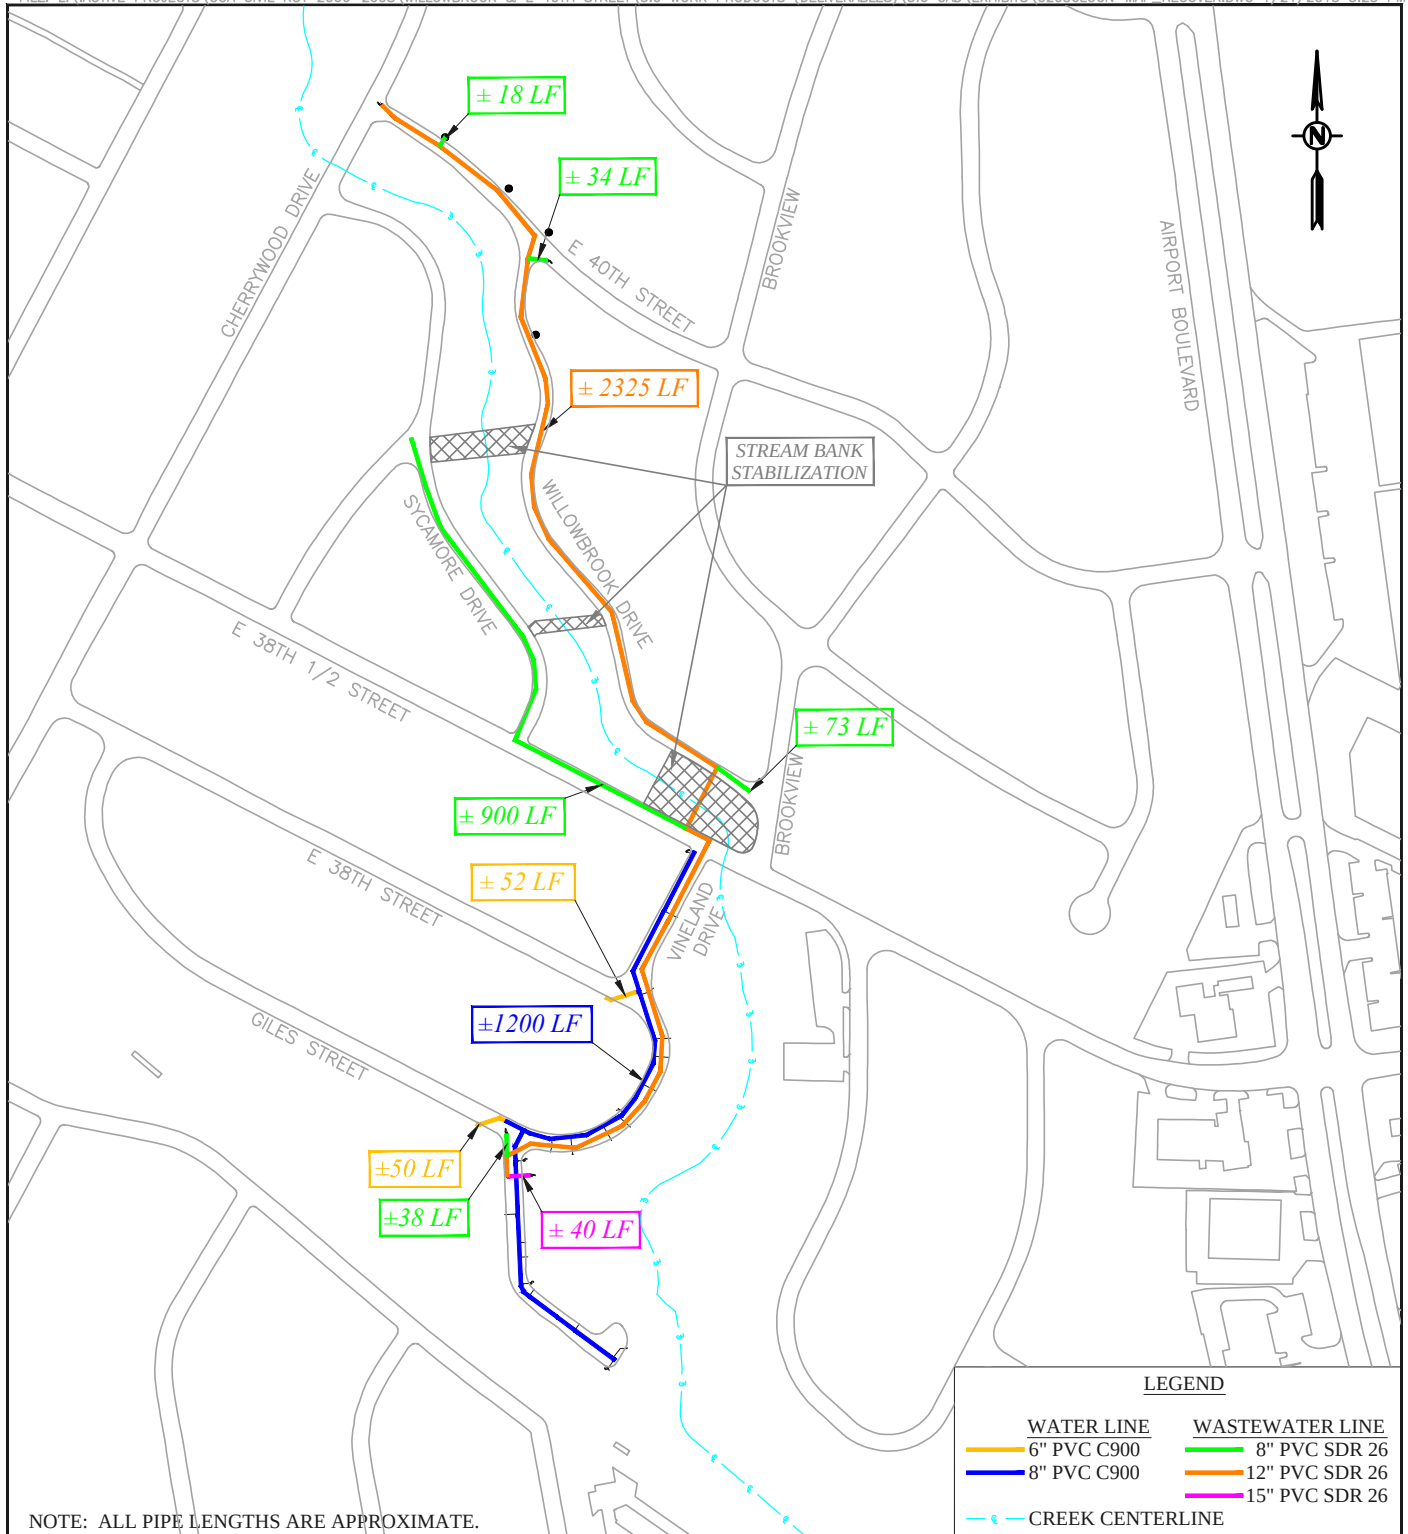

NOTE: ALL PIPE LENGTHS ARE APPROXIMATE.

CITY GRID: K 24, BOGGY CREEK WATERSHED

MAPSCO GRID: 585D&585H

N.T.S.

NOTE: SITE IS IN THE CENTRAL PRESSURE ZONE. OPERATING PRESSURE RANGE IS 59-74 PSI WITH 70 PSI TYPICAL.



CITY OF AUSTIN

WILLOWBROOK
WASTEWATER IMPROVEMENTS



CAS CONSULTING
& SERVICES INC

7908 CAMERON RD
AUSTIN, TEXAS 78754
REG. No. F-003572

PRE-BID
EXHIBIT