


NOTE:
1. FIRE TAPS BY OTHERS.

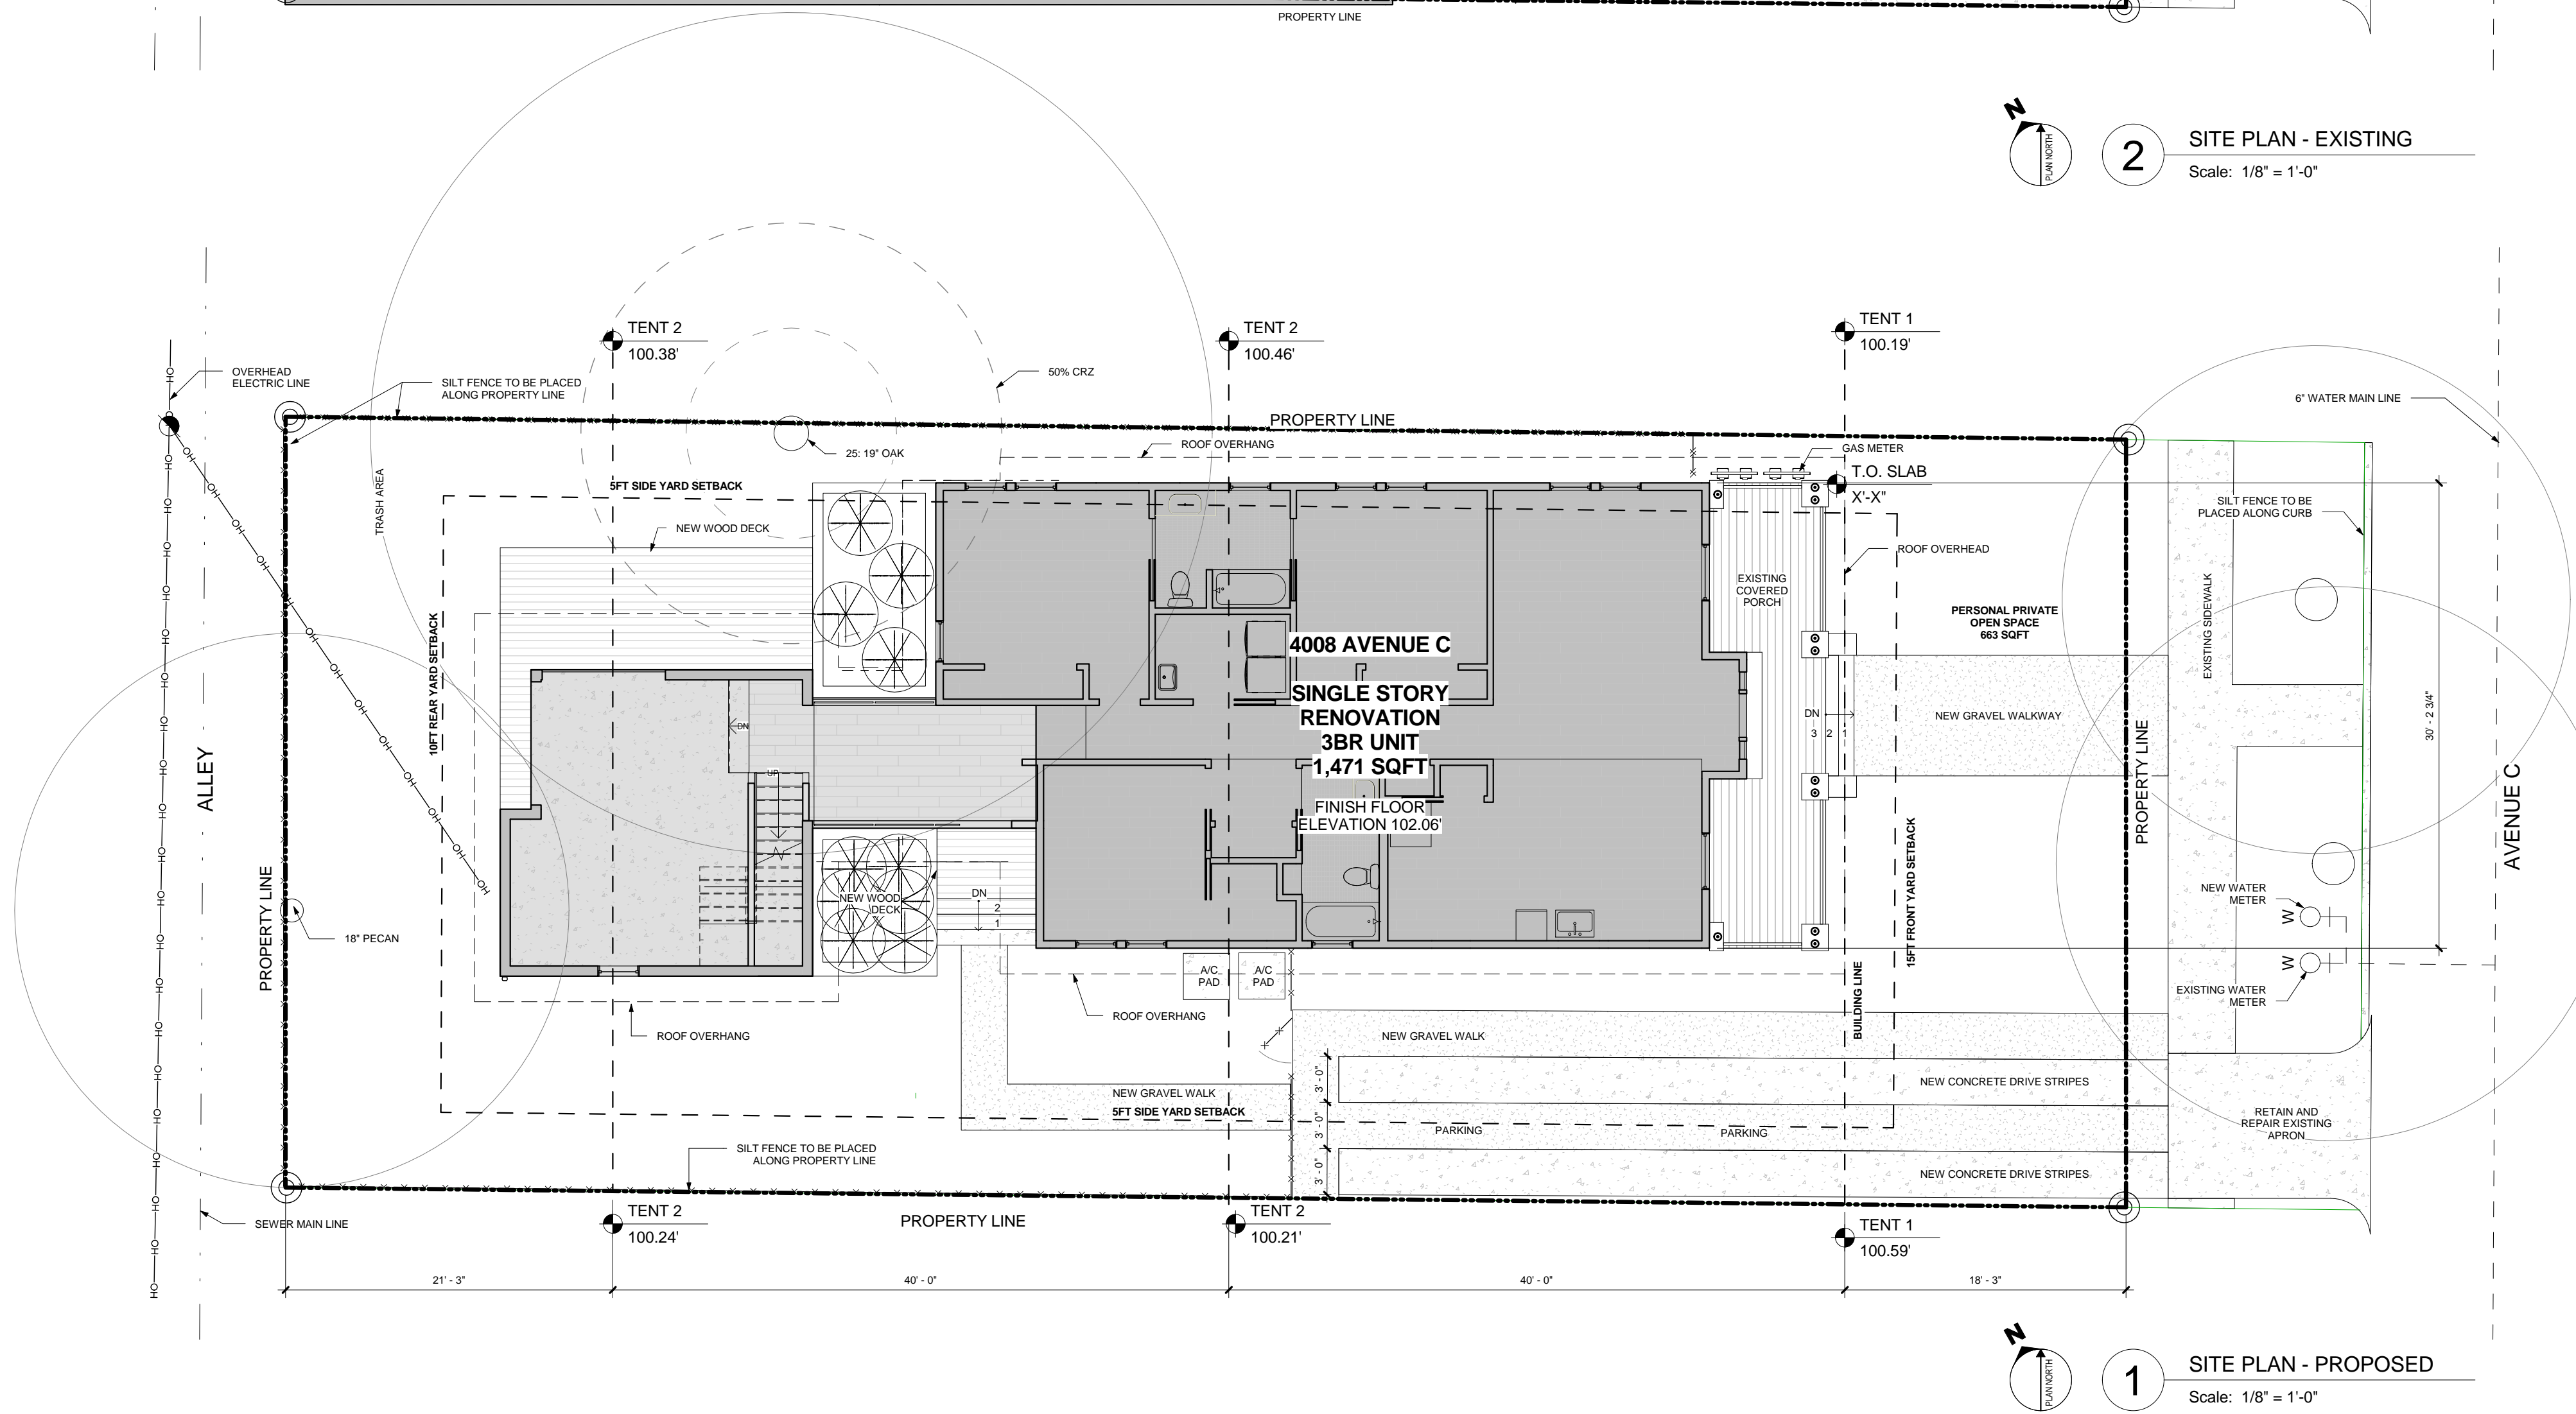

PROJECT DESCRIPTION
AN INTERIOR REMODEL OF A SINGLE STORY STRUCTURE WITH A TWO STORY ADDITION AT THE REAR

LEGAL DESCRIPTION
LOTS 27 & 28, BLK. 6; HYDE PARK, ADDITION TWO

ZONING	
ZONING	SF-3-HD-NCCD-NP
LAND USE	SINGLE FAMILY
LOT AREA	5,964.8 SQFT

TYPE OF CONSTRUCTION
TYPE V-B

BUILDING AREA	EXISTING (SQFT)	PROPOSED (SQFT)	ALLOWED (SQFT)
FIRST FLOOR CONDITIONED	1,667	1,867	
SECOND FLOOR CONDITIONED	0	443	
TOTAL ZONING SQ FT (GROSS FLOOR AREA)	1,667 (0.28:1)	2310 (0.39:1)	2385.9 (0.4:1)
COVERED PARKING (GARAGE OR CARPORT)	703	150	
COVERED PATIO, DECK OR PORCH	228	228	
COVERED BALCONY	0	0	
BUILDING SQ FT (FLOOR AREA)	2,598	2,688	
# OF BLDG FLOORS	1	2	
# OF UNITS	5	2	
# PARKING SPACES	4	3	

SITE AREA	EXISTING (SQFT)	PROPOSED (SQFT)	ALLOWED (SQFT)
BUILDING SQ FT (EXC. SECOND FLOOR)	2,600	2245	
PARKING	598	390	
PAVED WALKWAYS	150	0	
UNCOVERED PATIOS	0	0	
UNCOVERED WOOD DECKS (50%)	75	11	
AC PADS	9	18	
TOTAL IMPERVIOUS COVER	3,432 (57.5%)	2663 (44.7%)	2684 (45%)

PARKING SUMMARY	
PARKING RATIO REQ'D PER UNIT	
- DWELLING UNIT	2 SPACES
- ACCESSORY DWELLING UNIT	1 SPACE
# SPACES	3 SPACES
ADA SPACES REQUIRED	0 SPACES
20% URBAN CORE REDUCTION	-0.6 SPACES
TOTAL REQUIRED	3 SPACES

KEY	
	PROPERTY LINE
	4' WOOD FENCE
	6' WOOD FENCE
	OVERHEAD ELECTRIC
	UTILITY POLE
	WATER METER

TREE PROTECTION NOTES
THE FOLLOWING REQUIREMENTS APPLY TO ALL SIGNIFICANT TREES (TRUNK DIAMETER >8") WITHIN THE LIMITS OF CONSTRUCTION, AND MUST BE OBSERVED THROUGHOUT THE DURATION OF CONSTRUCTION
PROTECT TREE CRITICAL ROOT ZONES BY PUTTING UP CHAIN LINK FENCING, 5' MINIMUM, AT THE BOUNDARIES OF THE 50% CRITICAL ROOT ZONES (CRZ).
IF FENCING THE ENTIRE 50% CRZ IS INFEASIBLE, AN 8" LAYER OF MULCH MUST BE APPLIED TO AS MUCH OF THE CRZ AS POSSIBLE.
NOTWITHSTANDING FENCING OR MULCH LOCATIONS, NO MATERIALS OR EQUIPMENT MAY BE STORED WITHIN TREE CRITICAL ROOT ZONES.
ALL PRUNING OF SIGNIFICANT TREES, INCLUDING PRUNING TO ALLOW ACCESS TO MATERIALS AND EQUIPMENT, MUST BE DONE BY A LICENSED ARBORIST.

GENERAL NOTES - SITE PLAN
1 CONTRACTOR RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS.
2 TAKE MEASURE TO PROVIDE POSITIVE DRAINAGE AWAY FROM BUILDING.
3 SITE PLAN IS DRAWN FROM INFORMATION ON SURVEY DATED 8/26/2015.
4 ONLY TREES 19" DIAMETER AND GREATER ARE NOTED ON SITE PLAN - REFERENCE SITE SURVEY FOR FULL LIST OF TREES, TRUNK SIZE AND LOCATION.

THIS DRAWING IS THE PROPERTY OF THOUGHTBARN/DELINEATE STUDIO AND MAY NOT BE REPRODUCED OR USED WITHOUT WRITTEN PERMISSION.

ARCHITECT:
TB/DS
THOUGHTBARN/DELINEATE STUDIO
916 SPRINGDALE RD
BUILDING 5 / SUITE 102
AUSTIN, TX 78702
512.522.3511
WWW.THoughtBARN.COM
WWW.DELINEATESTUDIO.COM

PROJECT
4008 AVENUE C
4008 AVENUE C
AUSTIN, TX 78751

STAGE
100% DD

REVISIONS		
NUMBER	DATE	DESCRIPTION


DRAWING
SITE PLAN

DATE
12/9/17

PAGE NUMBER

A0.01

TB/DS
THOUGHTBARN/DELINEATE STUDIO

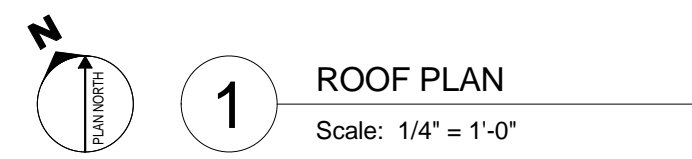

A1.07

GENERAL ELEVATION NOTES

- REFER TO MECHANICAL DRAWINGS FOR FREE AREA OF LOUVERS. VERIFY THAT SIZE AND LOCATION DOES NOT CONFLICT WITH CEILING HEIGHTS.
- PROVIDE ONE PRE-CAST CONCRETE SPLASH BLOCK AT EACH DOWNSPOUT EXTENDING 4" FROM BUILDING, UNLESS DOWNSPOUT IS TIED INTO STORM DRAIN OR DRAINS ON TO CONCRETE SURFACE. PROVIDE FACTORY FINISHED GALVANIZED STEEL 6" BOX GUTTERS WITH DOWNSPOUTS AT EAVES UNLESS NOTED OTHERWISE.
- GC REVIEW CONTROL JOINT LOCATIONS WITH STUCCO MANUFACTURER.
- ENCLOSED ATTIC AND RAFTER SPACES SHALL HAVE CROSS VENTILATION BY OPENINGS EQUAL TO 1/150TH OF THE AREA. WHERE EAVE OR CORNER CORNICE VENTS ARE INSTALLED, INSULATION SHALL NOT BLOCK THE FREE FLOW OF AIR (USE INSULATION BAFFLE). A MIN. 1" OF AIR SPACE SHALL BE PROVIDED BETWEEN THE INSULATION AND ROOF SHEATHING. ROOFS WITH RAFTERS, BAYS, AND/OR VAULTED CEILINGS MUST BE VENTILATED TO OUTSIDE THE RIDGE.
- SALVAGE AND REPAIR EXTG. EXTERIOR MATERIALS WHERE POSSIBL. UNLESS NOTED OTHERWISE
- EXISTING HOUSE TO BE RAISED 14" FOR NEW FOUNDATION SYSTEM.

EXTERIOR MATERIAL LEGEND

	DESCRIPTION
BRICK 1	EXISTING COMMON BRICK, PAINTED, COLOR TBD
CONC 1	CONCRETE WALKWAY
CONC 2	CONCRETE DRIVEWAY
CONC 3	EXISTING CONCRETE
GLASS 1	GLAZING
GRASS	GRASS SOD
GRAVEL	GRAVEL
GTR 1	METAL GUTTER AND DOWNSPOUT SYSTEM
METAL 1	STANDING SEAM METAL ROOF
METAL 3	1/4" STEEL PLATE, PAINTED, COLOR TO BE SELECTED BY ARCH.
PLY-1	PLYWOOD, SHEATHING GRADE
SHINGLE 1	RECYCLED PLASTIC SHINGLE
STUCCO 1	GYP-SUM BOARD; GYP-1 LEVEL 5, PAINTED
WD	EXTERIOR WESTERN RED CEDAR T&G
WOOD 1	EXISTING WOOD SIDING, PAINTED WHITE, COLOR TO BE SELECTED BY ARCH.
WOOD 2	NEW WOOD SIDING TO MATCH EXISTING, PAINTED WHITE, COLOR TO BE SELECTED BY ARCH.
WOOD 4	NEW WOOD DECKING, 5/4"x4" BOARDS, STAINED OR PAINTED, COLOR TBD
WOOD SOFFIT	EXISTING WOOD DECK



2 SOUTH ELEVATION
Scale: 1/4" = 1'-0"



1 NORTH ELEVATION
Scale: 1/4" = 1'-0"

ARCHITECT:

TB/DS
THOUGHTBARN/DELINEATE STUDIO
916 SPRINGDALE RD
BUILDING 5 / SUITE 102
AUSTIN, TX 78702
512.522.3511
WWW.THoughtBARN.COM
WWW.DELINEATESTUDIO.COM

PROJECT

4008 AVENUE C
4008 AVENUE C
AUSTIN, TX 78751

STAGE

100% DD

REVISIONS

NUMBER	DATE	DESCRIPTION

DRAWING


**EXTERIOR
ELEVATIONS**

DATE

12/9/17

PAGE NUMBER

A2.02

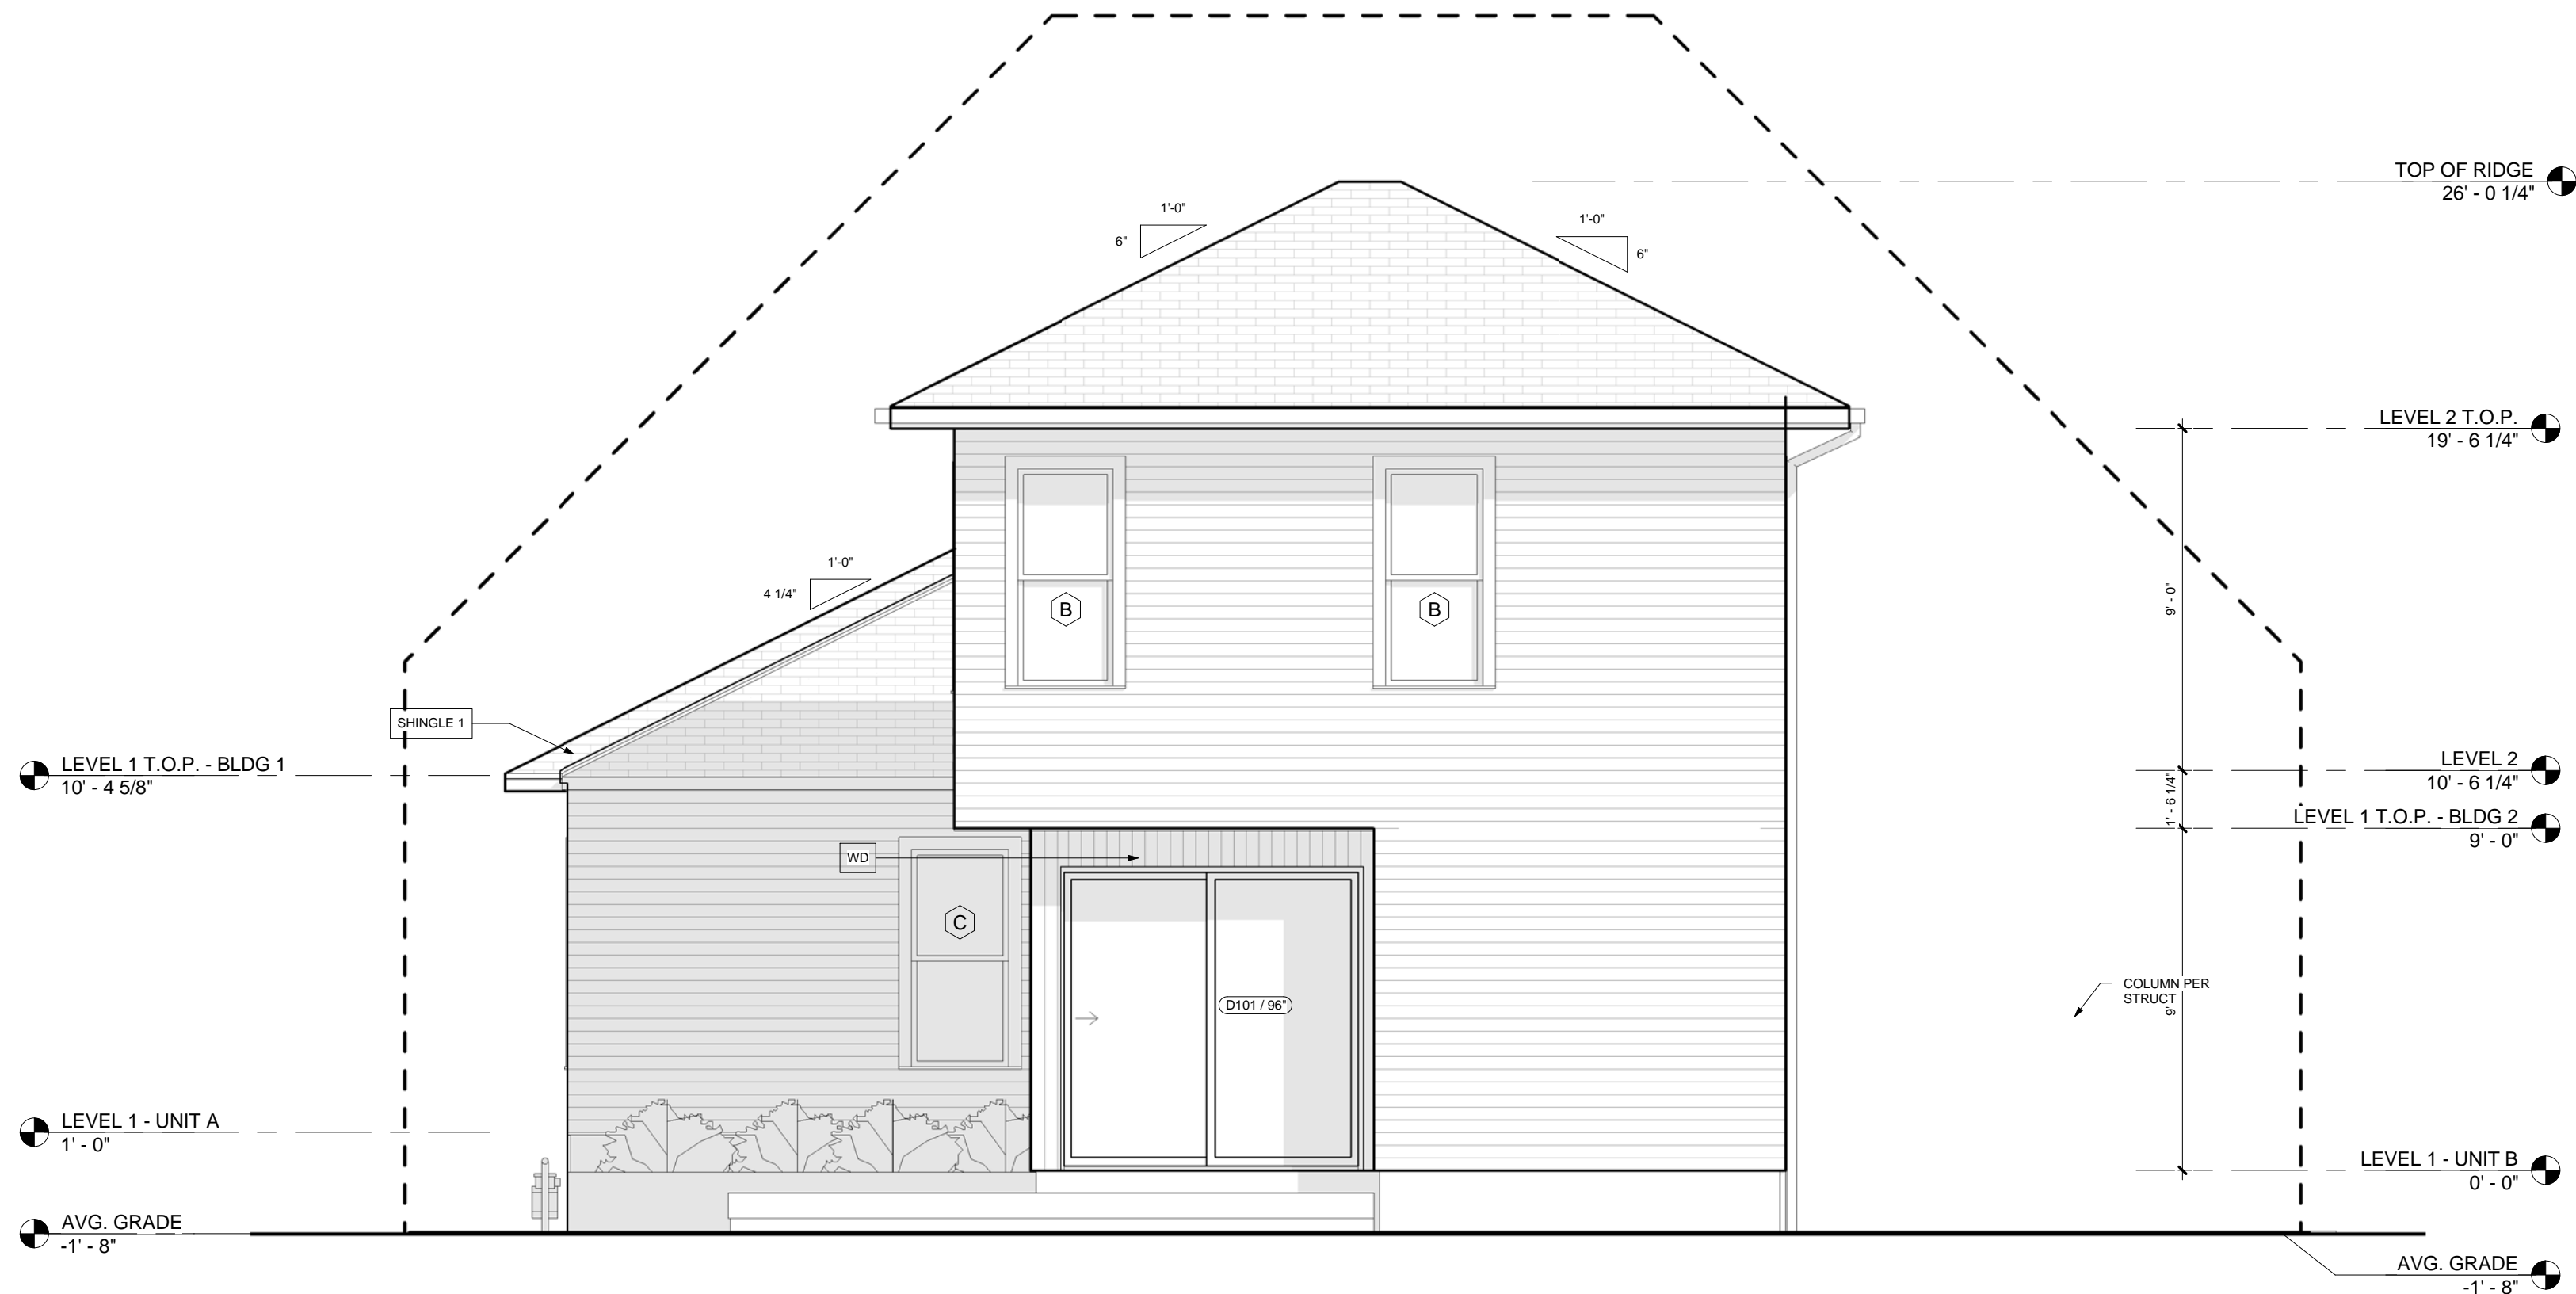

2 WEST ELEVATION
Scale: 1/4" = 1'-0"



1 EAST ELEVATION
Scale: 1/4" = 1'-0"

EXTERIOR MATERIAL LEGEND	
	DESCRIPTION
BRICK 1	EXISTING COMMON BRICK, PAINTED, COLOR TBD
CONC 1	CONCRETE WALKWAY
CONC 2	CONCRETE DRIVEWAY
CONC 3	EXISTING CONCRETE
GLASS 1	GLAZING
GRASS	GRASS SOD
GRAVEL	GRAVEL
GTR 1	METAL GUTTER AND DOWNSPOUT SYSTEM
METAL 1	STANDING SEAM METAL ROOF
METAL 3	1/4" STEEL PLATE, PAINTED, COLOR TO BE SELECTED BY ARCH.
PLY-1	PLYWOOD, SHEATHING GRADE
SHINGLE 1	RECYCLED PLASTIC SHINGLE
STUCCO 1	GYP-SUM BOARD; GYP-1 LEVEL 5, PAINTED
WD	EXTERIOR WESTERN RED CEDAR T&G
WOOD 1	EXISTING WOOD SIDING, PAINTED WHITE, COLOR TO BE SELECTED BY ARCH.
WOOD 2	NEW WOOD SIDING TO MATCH EXISTING, PAINTED WHITE, COLOR TO BE SELECTED BY ARCH.
WOOD 4	NEW WOOD DECKING, 5/4"x4" BOARDS, STAINED OR PAINTED, COLOR TBD
WOOD SOFFIT	EXISTING WOOD DECK

GENERAL ELEVATION NOTES

- REFER TO MECHANICAL DRAWINGS FOR FREE AREA OF LOUVERS. VERIFY THAT SIZE AND LOCATION DOES NOT CONFLICT WITH CEILING HEIGHTS.
- PROVIDE ONE PRE-CAST CONCRETE SPLASH BLOCK AT EACH DOWNSPOUT EXTENDING 4" FROM BUILDING, UNLESS DOWNSPOUT IS TIED INTO STORM DRAIN OR DRAINS ON TO CONCRETE SURFACE. PROVIDE FACTORY FINISHED GALVANIZED STEEL 6" BOX GUTTERS WITH DOWNSPOUTS AT EAVES UNLESS NOTED OTHERWISE.
- GC REVIEW CONTROL JOINT LOCATIONS WITH STUCCO MANUFACTURER.
- ENCLOSED ATTIC AND RAFTER SPACES SHALL HAVE CROSS VENTILATION BY OPENINGS EQUAL TO 1/150TH OF THE AREA. WHERE EAVE OR CORNER CORNICE VENTS ARE INSTALLED, INSULATION SHALL NOT BLOCK THE FREE FLOW OF AIR (USE INSULATION BAFFLE). A MIN. 1" OF AIR SPACE SHALL BE PROVIDED BETWEEN THE INSULATION AND ROOF SHEATHING. ROOFS WITH RAFTERS, BAYS, AND/OR VAULTED CEILINGS MUST BE VENTILATED TO OUTSIDE THE RIDGE.
- SALVAGE AND REPAIR EXTG. EXTERIOR MATERIALS WHERE POSSIBL. UNLESS NOTED OTHERWISE
- EXISTING HOUSE TO BE RAISED 14" FOR NEW FOUNDATION SYSTEM.

TB/DS

THOUGHTBARN/DELINEATE STUDIO

ARCHITECT:
TB/DS
THOUGHTBARN/DELINEATE STUDIO
916 SPRINGDALE RD
BUILDING 5 / SUITE 102
AUSTIN, TX 78702
512 522 3511
WWW.THOUGHTBARN.COM
WWW.DELINEATESTUDIO.COM

PROJECT
4008 AVENUE C
4008 AVENUE C
AUSTIN, TX 78751

STAGE
100% DD

REVISIONS
NUMBER DATE DESCRIPTION

DRAWING
EXTERIOR ELEVATIONS

DATE
12/9/17


PAGE NUMBER
A2.03



4008 AVENUE C/ DESIGN UPDATE 1.4.18



4008 AVENUE C/ DESIGN UPDATE 1.4.18

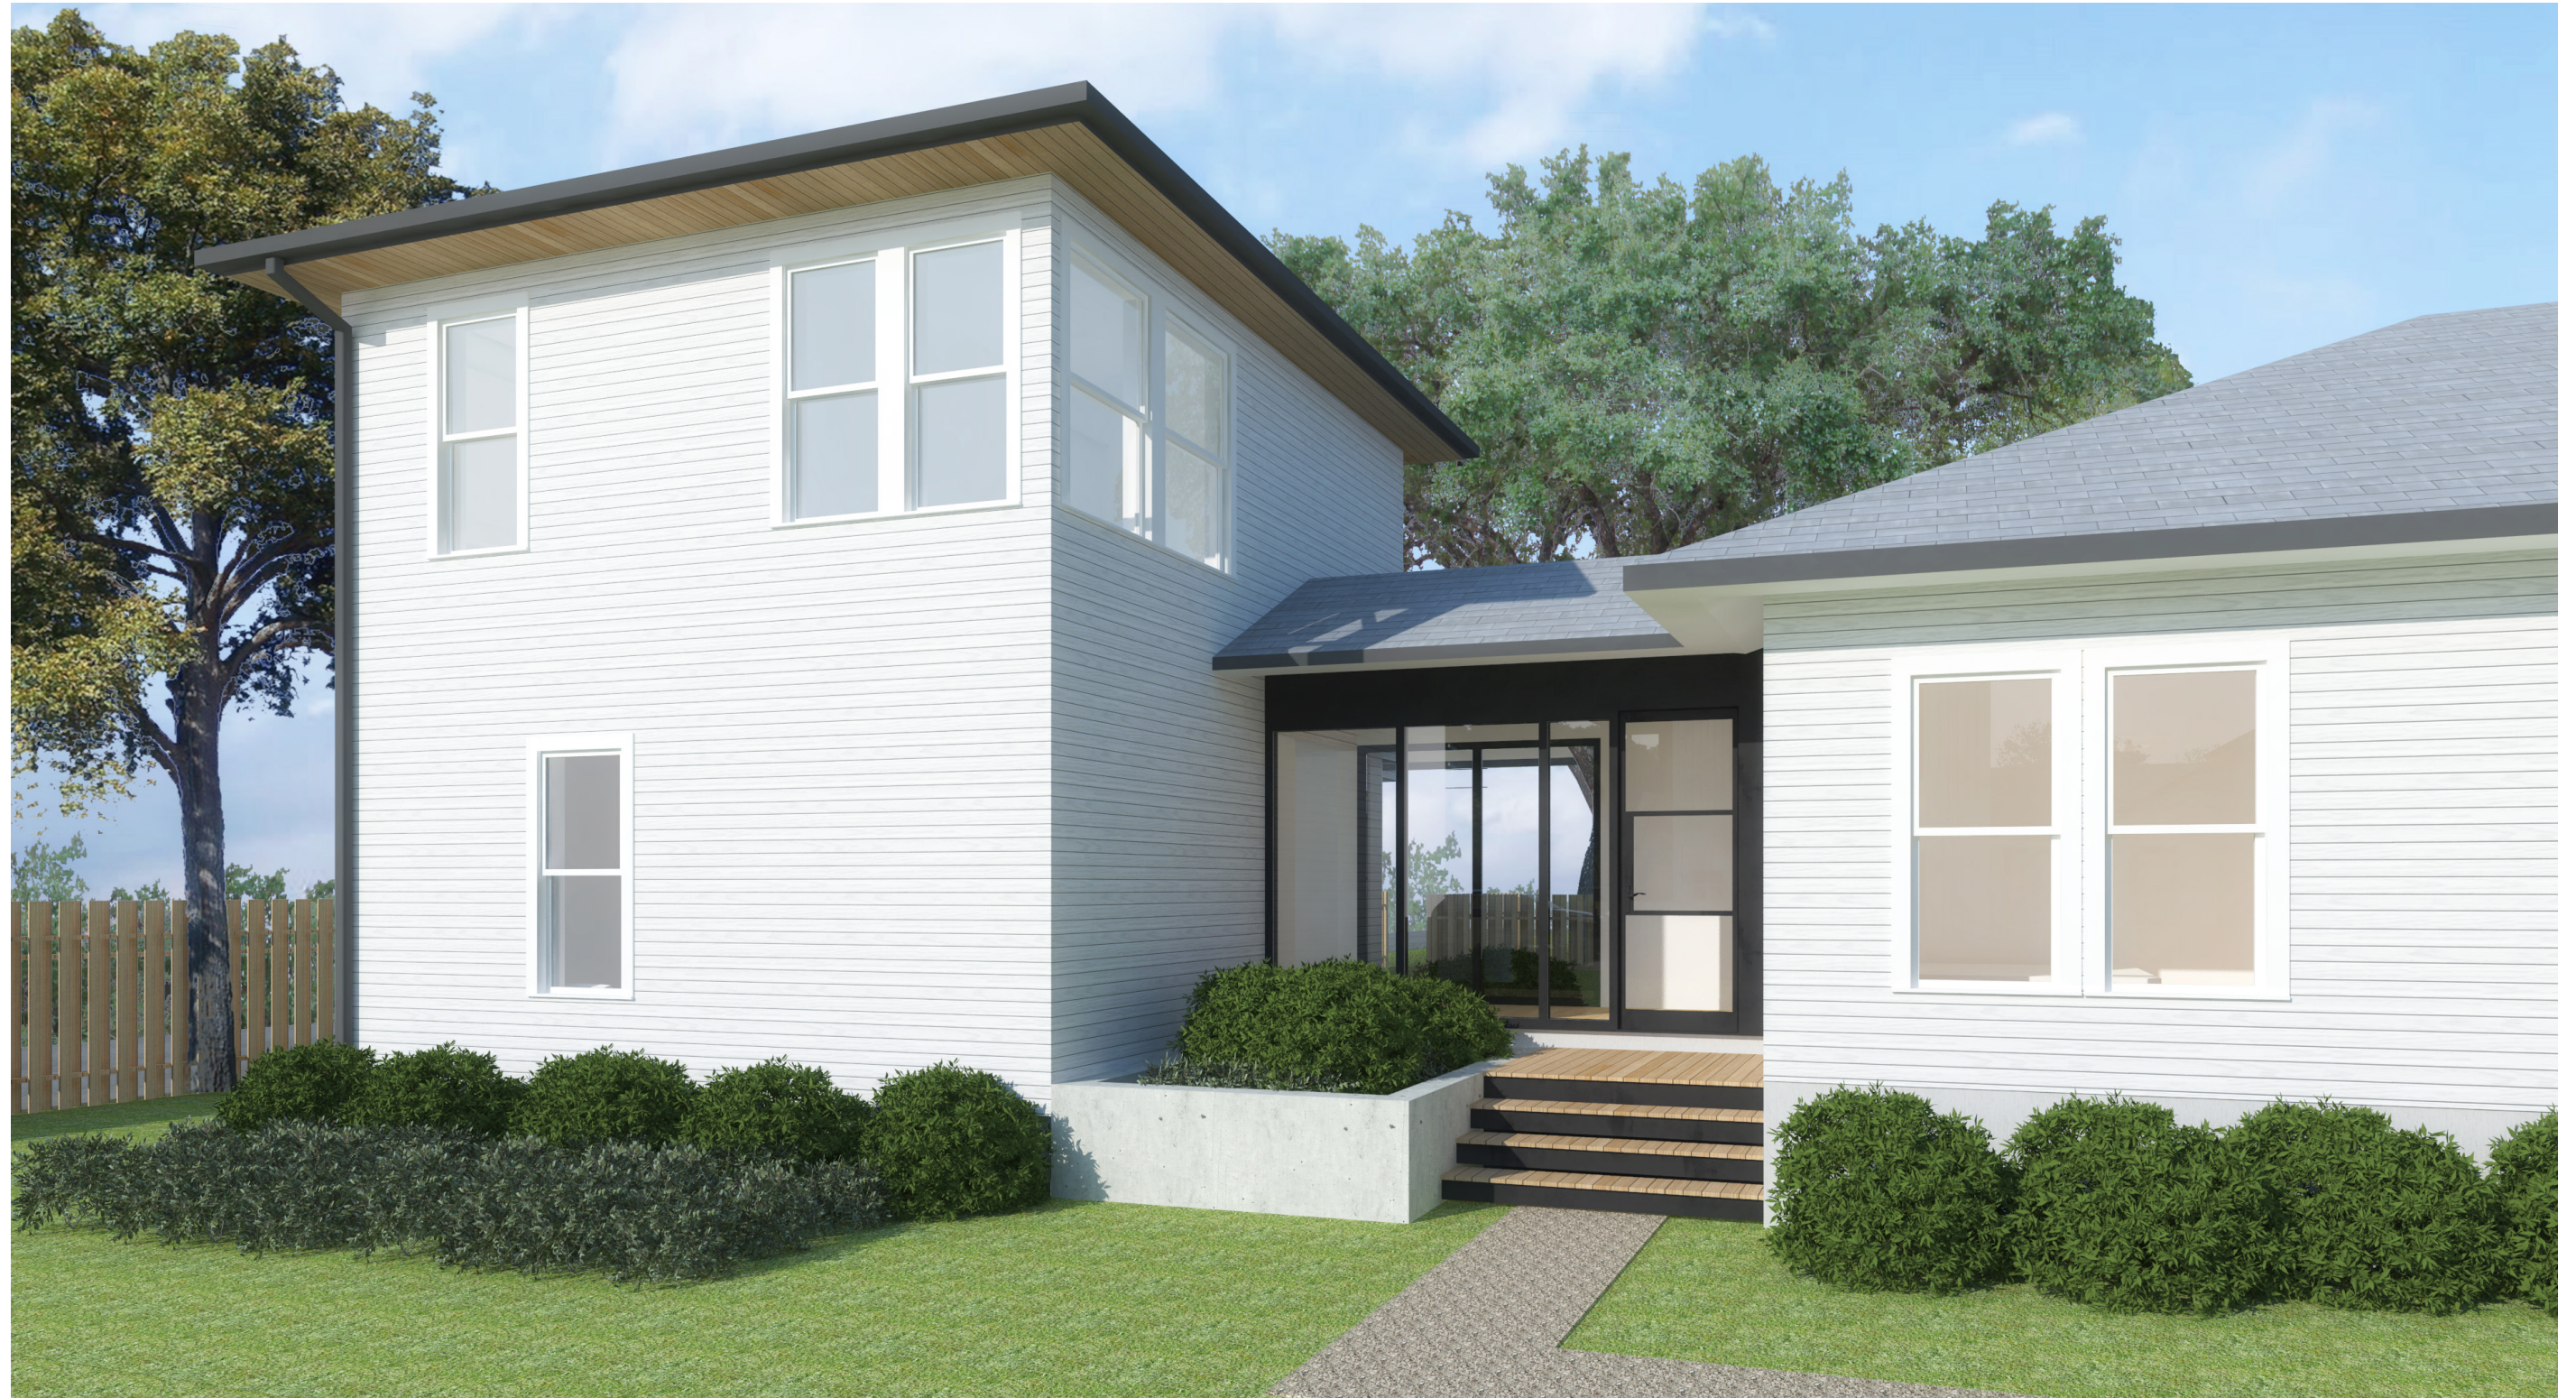

4008 AVENUE C/ DESIGN UPDATE 1.4.18