


SECTION A



CITY OF CHARLOTTE
 LAND DEVELOPMENT STANDARDS
 INCLUDES CHARLOTTE ETJ

LARGE AND SMALL MATURING TREE PIT
 WITH GRATE IN SIDEWALK (SECTION)

STD. NO.	REV.
40.03A	3

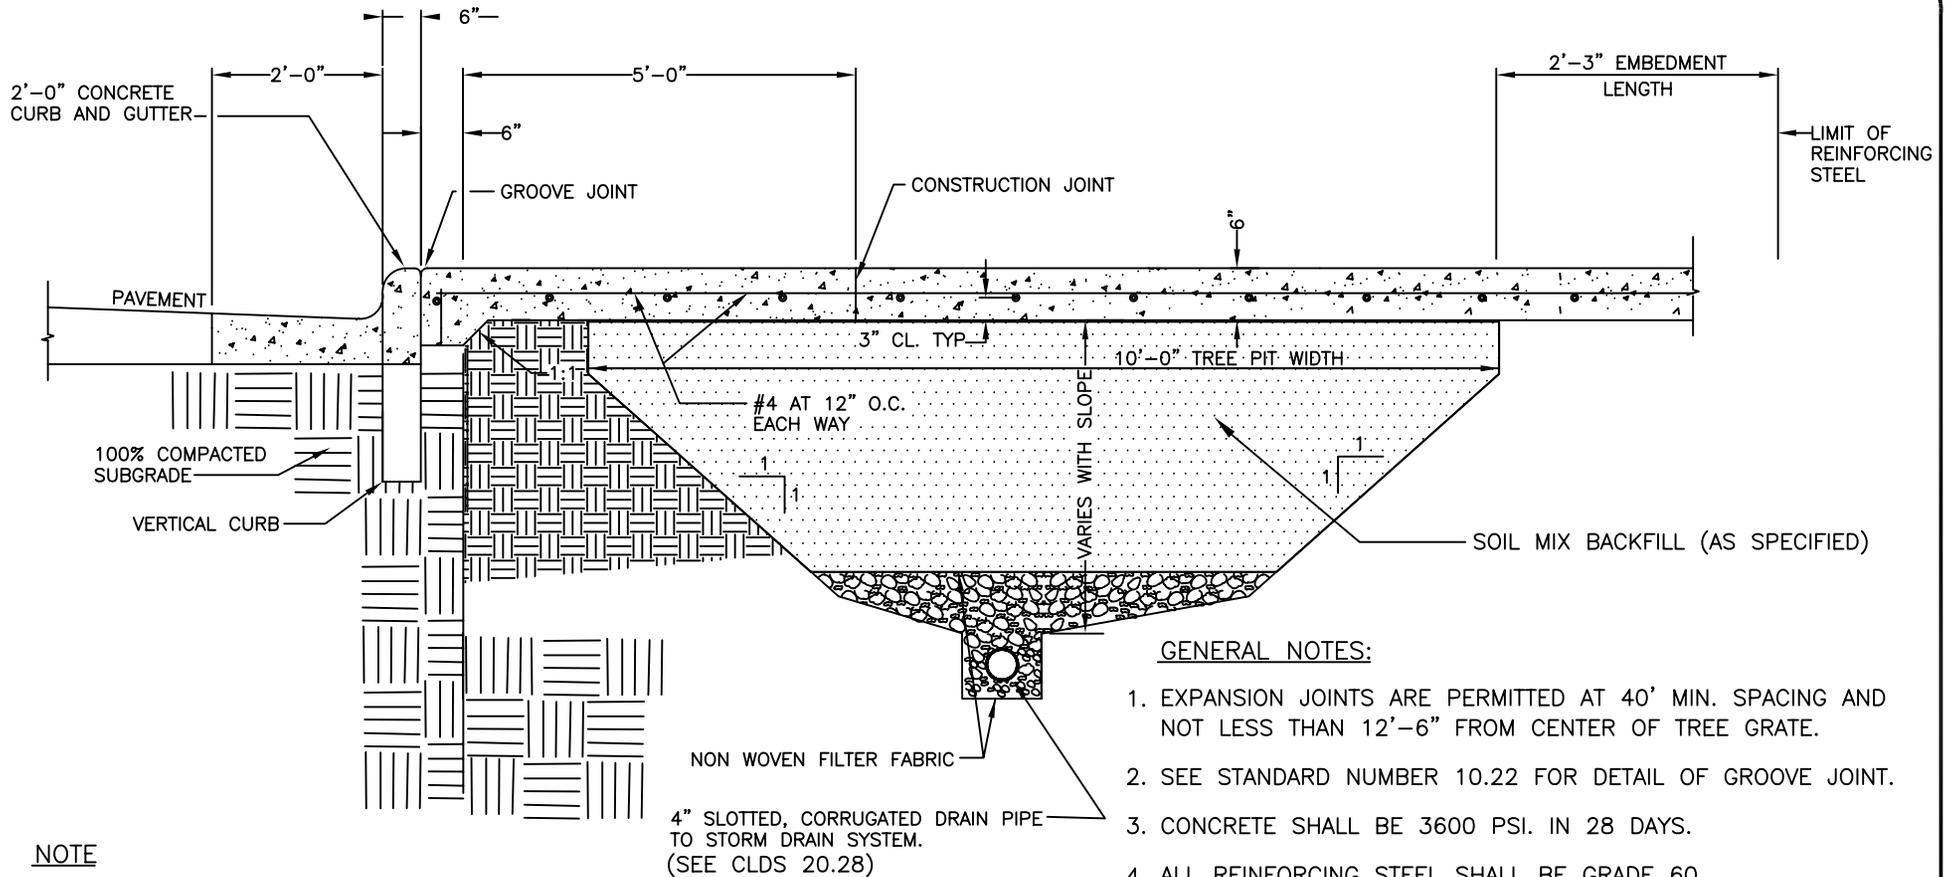

NOTE

A DRAINAGE SYSTEM IS REQUIRED AS SHOWN FOR ALL IRRIGATED PLANTING AREAS LOCATED ADJACENT TO STREET.

GENERAL NOTES:

1. EXPANSION JOINTS ARE PERMITTED AT 40' MIN. SPACING AND NOT LESS THAN 12'-6" FROM CENTER OF TREE GRATE.
2. SEE STANDARD NUMBER 10.22 FOR DETAIL OF GROOVE JOINT.
3. CONCRETE SHALL BE 3600 PSI. IN 28 DAYS.
4. ALL REINFORCING STEEL SHALL BE GRADE 60.
5. USE REINFORCED STEEL BAR SUPPORTS IN COMPLIANCE WITH N.C.D.O.T. STANDARD SPECIFICATION 970-4.


SECTION C



**CITY OF CHARLOTTE
LAND DEVELOPMENT STANDARDS
INCLUDES CHARLOTTE ETJ**

**LARGE AND SMALL TREE PIT WITH
GRATE IN SIDEWALK (SECTION)**

STD. NO.	REV.
40.03C	3

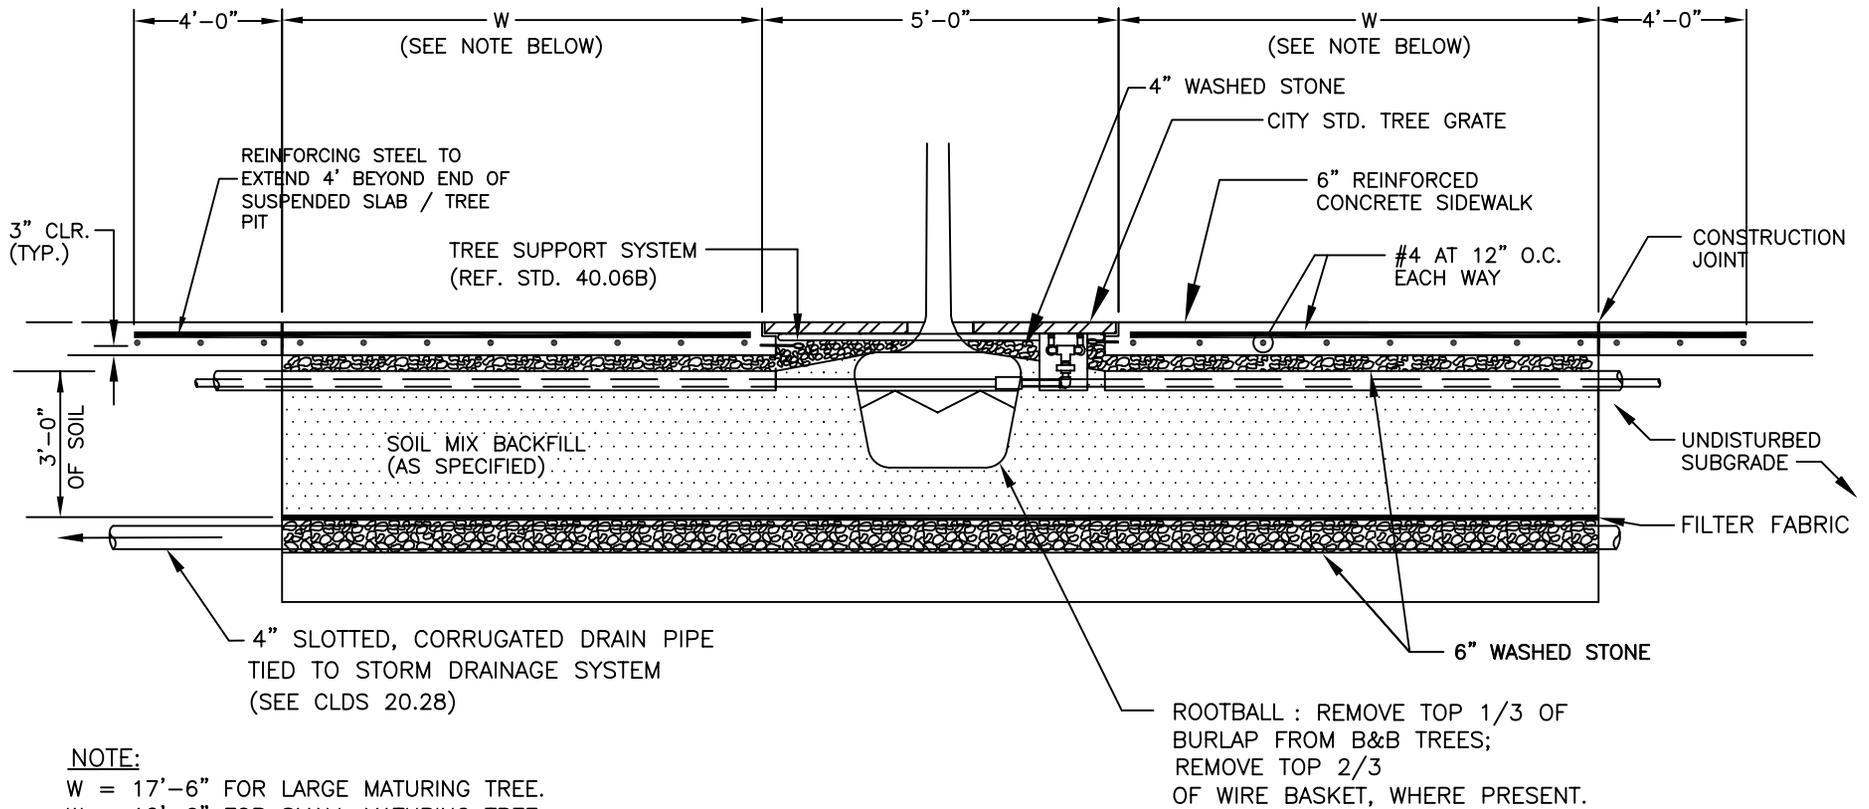

SECTION B



CITY OF CHARLOTTE
 LAND DEVELOPMENT STANDARDS
 INCLUDES CHARLOTTE ETJ

LARGE AND SMALL MATURING TREE PIT
 WITH GRATE IN SIDEWALK (SECTION)

STD. NO.	REV.
40.03B	3