

**ORDINANCE NO. 20190523-006**

**AN ORDINANCE AUTHORIZING AN AMENDMENT TO ORDINANCE NO. 20180911-002 TO INCREASE THE INDUSTRIAL WASTE SURCHARGE FOR EXCESSIVE AMMONIA-NITROGEN.**

**BE IT ORDAINED BY THE CITY COUNCIL OF THE CITY OF AUSTIN:**

**PART 1.** The City Council authorizes an amendment to the fees, fines, and other charges adopted by Ordinance No. 20180911-002 to change the surcharge for industrial waste in accordance with the attached Exhibit "A".

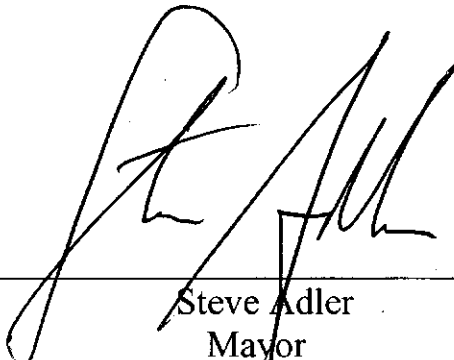
**PART 2.** To the extent that a previous ordinance conflicts with this ordinance, the earlier ordinance is repealed.

**PART 3.** This ordinance takes effect on June 3, 2019.


**PASSED AND APPROVED**

\_\_\_\_\_, May 23, 2019


§  
§  
§

  
\_\_\_\_\_  
Steve Adler  
Mayor

**APPROVED:**

  
\_\_\_\_\_  
Anne L. Morgan  
City Attorney

**ATTEST:**

  
\_\_\_\_\_  
Jannette S. Goodall  
City Clerk

**CITY OF AUSTIN, TEXAS  
AUSTIN WATER**

**PROPOSED WATER RATES  
FY 2018-19**

**PROPOSED RATES EFFECTIVE June 3, 2019  
(Rates for bills generated on or after June 3, 2019)**

**Industrial Waste Surcharge Rate for Ammonia-Nitrogen**

<b>Ammonia-Nitrogen</b>	<b><u>Current Rate</u></b>	<b><u>Proposed Rate</u></b>
	<b>\$1.559</b>	<b>\$1.641</b>

Increase the current rate of \$1.559 to \$1.641 per pound of ammonia-nitrogen discharged into Austin Water's wastewater system by an Industrial User when the ammonia-nitrogen concentration is in excess of 35 mg/l. The surcharge fee for ammonia nitrogen will be charged to an Industrial User that uses or produces ammonia-nitrogen in a manufacturing process. The surcharge fee for ammonia-nitrogen will be determined by calculating the difference between the average concentrations discharged from such an Industrial User and the 35 mg/l threshold as described in the formula below:

$$\text{Surcharge fee for ammonia-nitrogen} = \text{Volume of wastewater discharged (in millions of gallons)} \times 8.34 \text{ pounds per gallon} \times [\$1.641 \text{ per pound} \times (\text{Industrial User's average ammonia-nitrogen (in mg/l)} - 35 \text{ mg/l})]$$

Industrial Wastewater Surcharges for BOD, COD, or TSS remain unchanged.