


Sample Interior remodel proposed floor plan

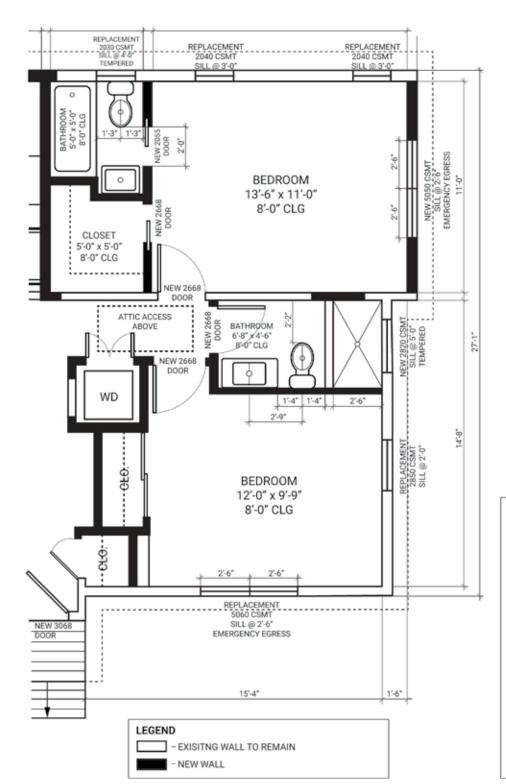

NOTES:

APPROVED CO ALARM SYSTEM SHALL BE INSTALLED OUTSIDE OF EACH SEPARATED SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN THE DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS THAT HAVE ATTACHED GARAGE IN ACCOURDANCE WITH IRC 2012 SEC R315.1

SMOKE DETECTOR SYSTEM HARD-WIRED, INTERCONNECTED. BATTERY BACKUP, AT EACH SLEEPING ROOM AND VICINITY. IN ACCORDANCE WITH IRC 2012 SEC R314

GENERAL CONTRACTOR SHALL VERIFY FOR SMOKE DETECTORS TO BE LOCATED AT LEAST 36" AWY FROM HORIZONTAL PATH OF MECHANICAL AIR FLOW, PER 2007 NFPA 72 CHAPTER 11

PROPOSED FLOOR PLAN

Interior remodel floor plan requirements

| Drawing scale |
|--|
| Show each floor |
| Square footage of building |
| Square footage of rooms |
| Ceiling height |
| Existing / New walls dimensions |
| Location of plumbing fixtures, appliances, fireplace |
| Window size and type (slider, pop-out) |
| Window sill height |
| Door size and type |
| Direction of door swing |
| Label rooms (eg: closets, bathrooms) |
| Comment about smoke detectors must be present |