

**NOTES:**

1. STONE SIZE: 75–125 mm (3–5") OPEN GRADED ROCK.
2. THICKNESS: NOT LESS THAN 200 mm (8").
3. WIDTH: NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS/EGRESS.


**CITY OF AUSTIN**  
DEPARTMENT OF PUBLIC WORKS

**POND MAINTENANCE ROAD  
CROSS SECTION**

\_\_\_\_\_ ADOPTED

THE ARCHITECT/ENGINEER ASSUMES  
RESPONSIBILITY FOR APPROPRIATE USE  
OF THIS STANDARD.

STANDARD NO.  
**662S-2**

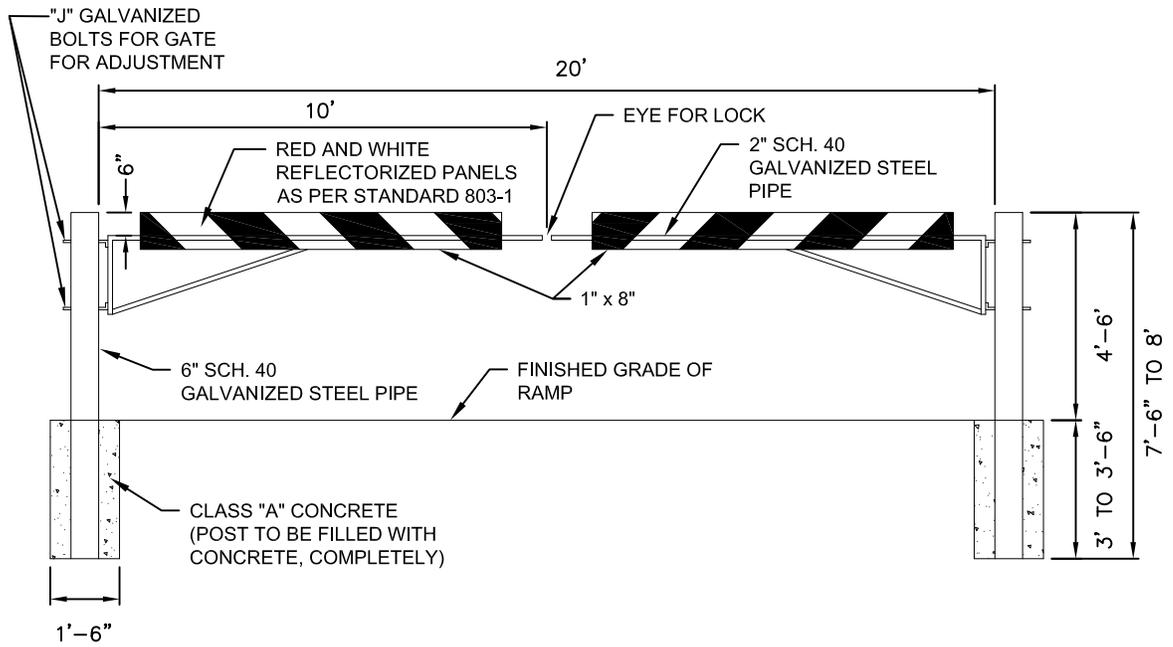

NOTE:  
 RAMP BARRICADE SUBSIDIARY  
 TO ITEM 403-G CONCRETE STRUCTURES


**CITY OF AUSTIN**  
 DEPARTMENT OF PUBLIC WORKS

**POND PIPE GATE AT RAMP DETAIL**

\_\_\_\_\_ ADOPTED

THE ARCHITECT/ENGINEER ASSUMES  
 RESPONSIBILITY FOR APPROPRIATE USE  
 OF THIS STANDARD.

STANDARD NO.  
**662S-1**

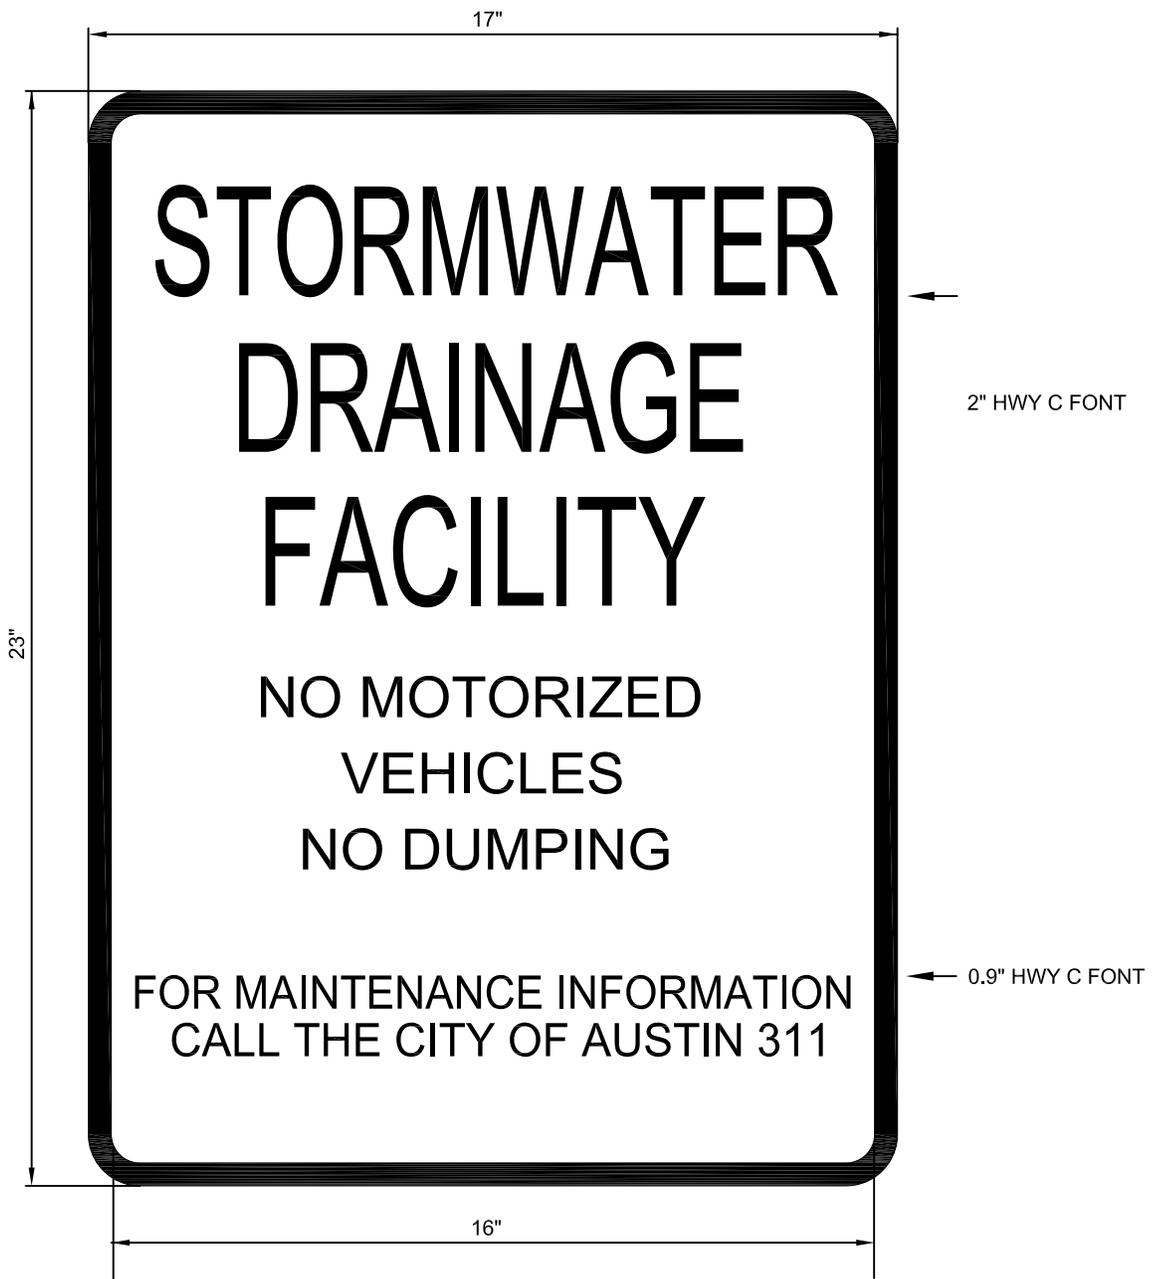

HEIGHT	24"
LENGTH	18"
THICKNESS	0.08"
SUBSTRATE	ALUMINUM ALLOY, 6061-T-6, OR TYPE IV 5052-H38 (ASTM B-209)
COLOR	LETTERING AND BORDER BLACK

**CITY OF AUSTIN**  
DEPARTMENT OF PUBLIC WORKS

**STORM WATER FACILITY SIGN**

THE ARCHITECT/ENGINEER ASSUMES  
RESPONSIBILITY FOR APPROPRIATE USE  
OF THIS STANDARD.

STANDARD NO.  
**662S-3**

ADOPTED